
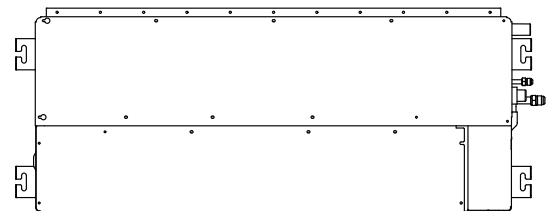
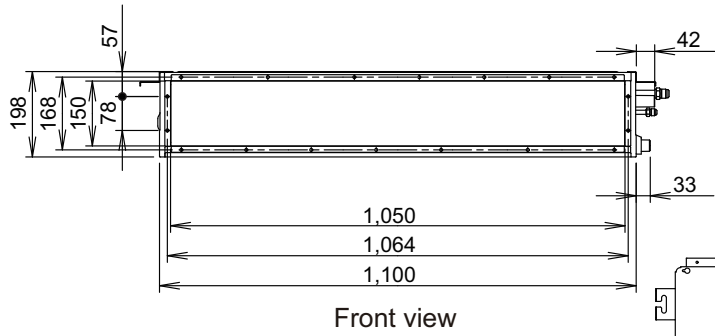
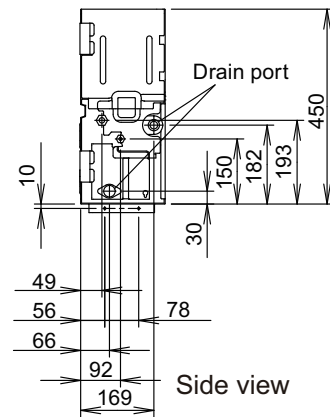
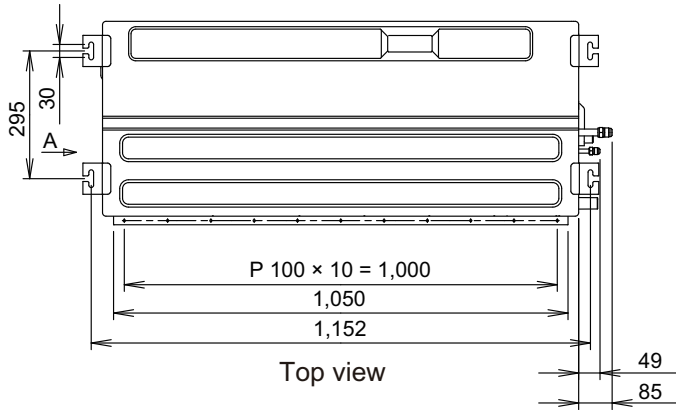



■ Model: ARXK024GLGH

Unit: mm

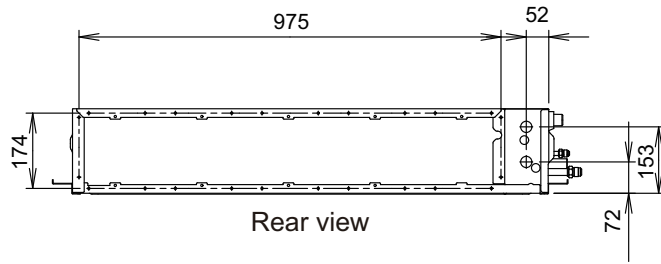


INDOOR
UNITS

INDOOR
UNITS

■ Installation space requirement


Provide sufficient installation space for product safety.

Unit: mm

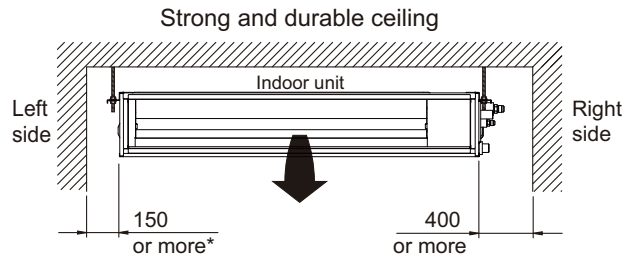


*: 400 or more when drain from drain pipe

- When intaking air from back:

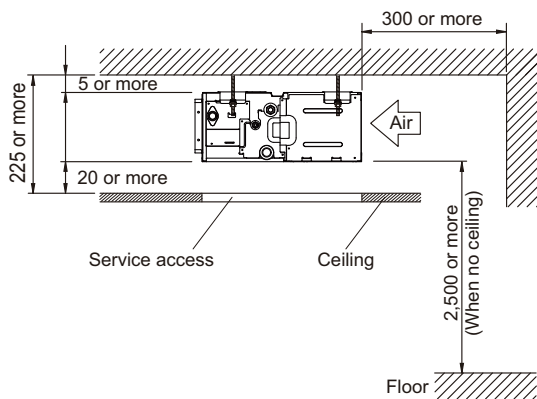

- When intaking air from bottom:

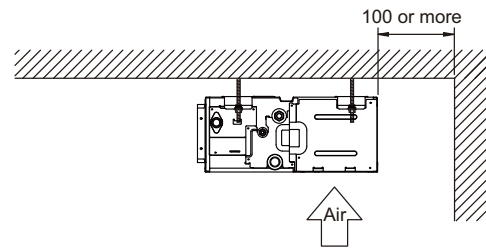


■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.

NOTE: Do not place any wiring or illumination in the maintenance space, as they will impede service.

Unit: mm

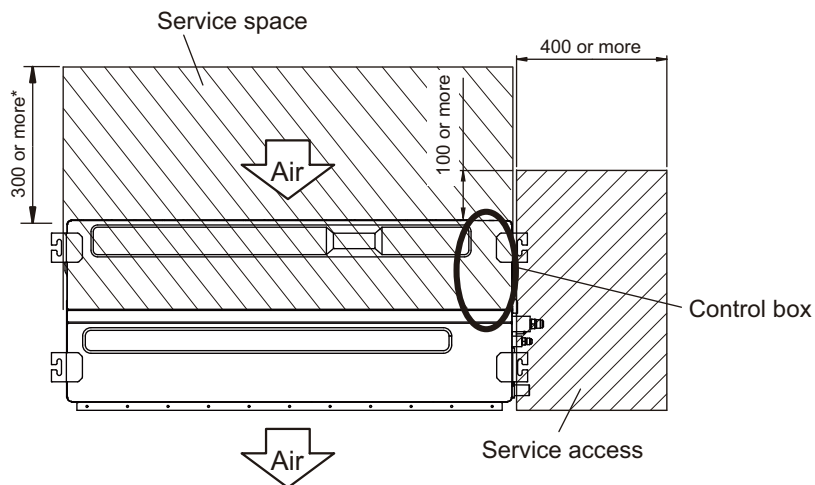

*: More than 100 when intaking air from bottom

Top view