



3-3. Slim duct type


■ Models: ARYG07LLTA, ARYG09LLTA, ARYG12LLTB, and ARYG14LLTB

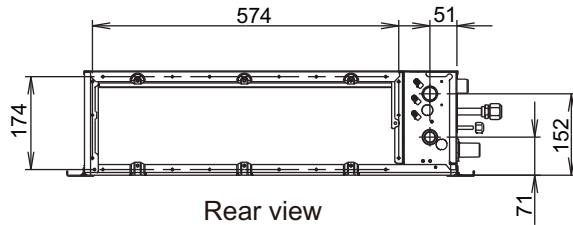


Rear view




View A

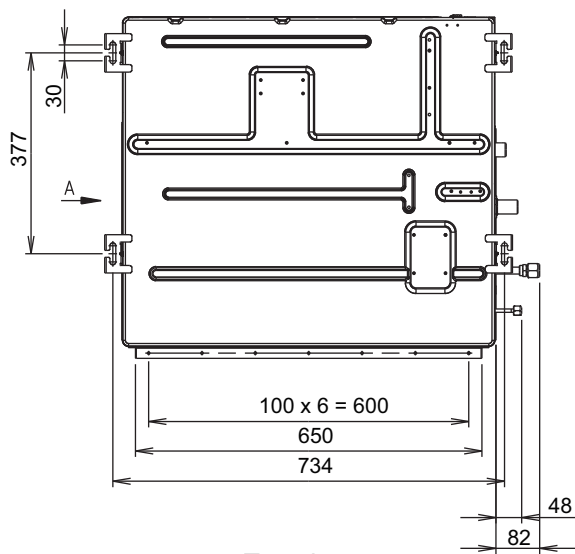


Top view

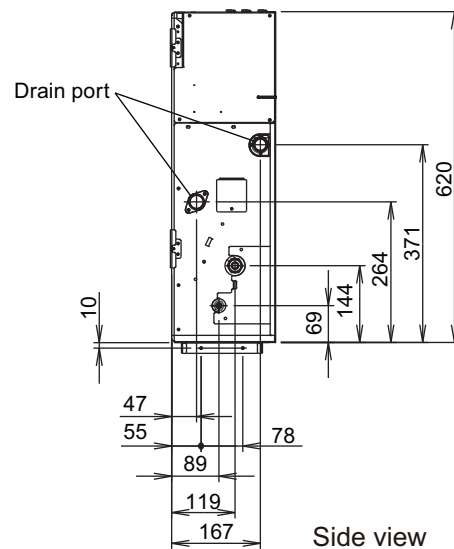

Side view

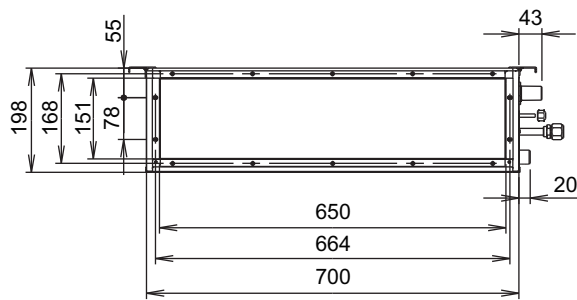

Front view

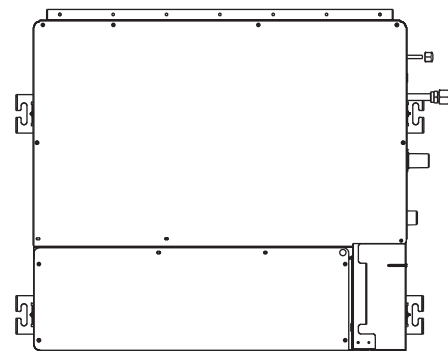


Bottom view


Installation space requirement

Provide sufficient installation space for product safety.

In ceiling-concealed installations:

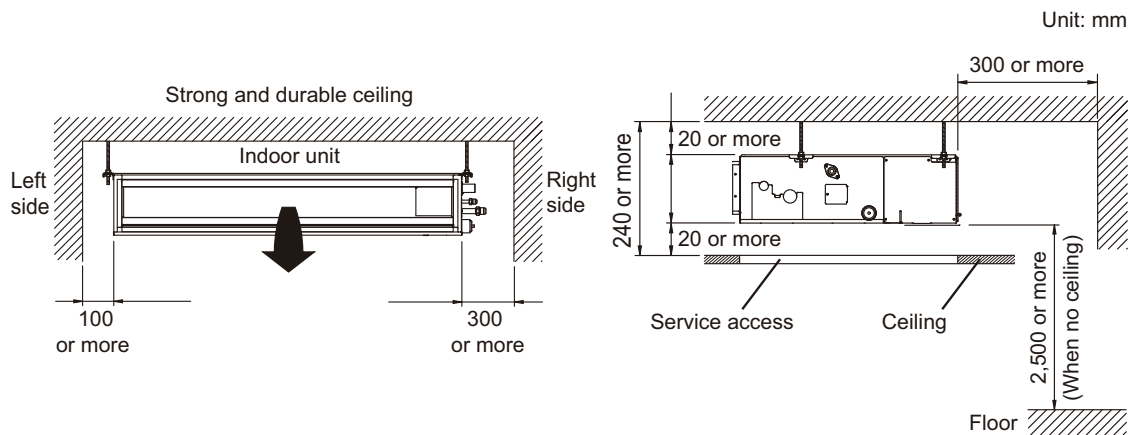

In wall-concealed installations:

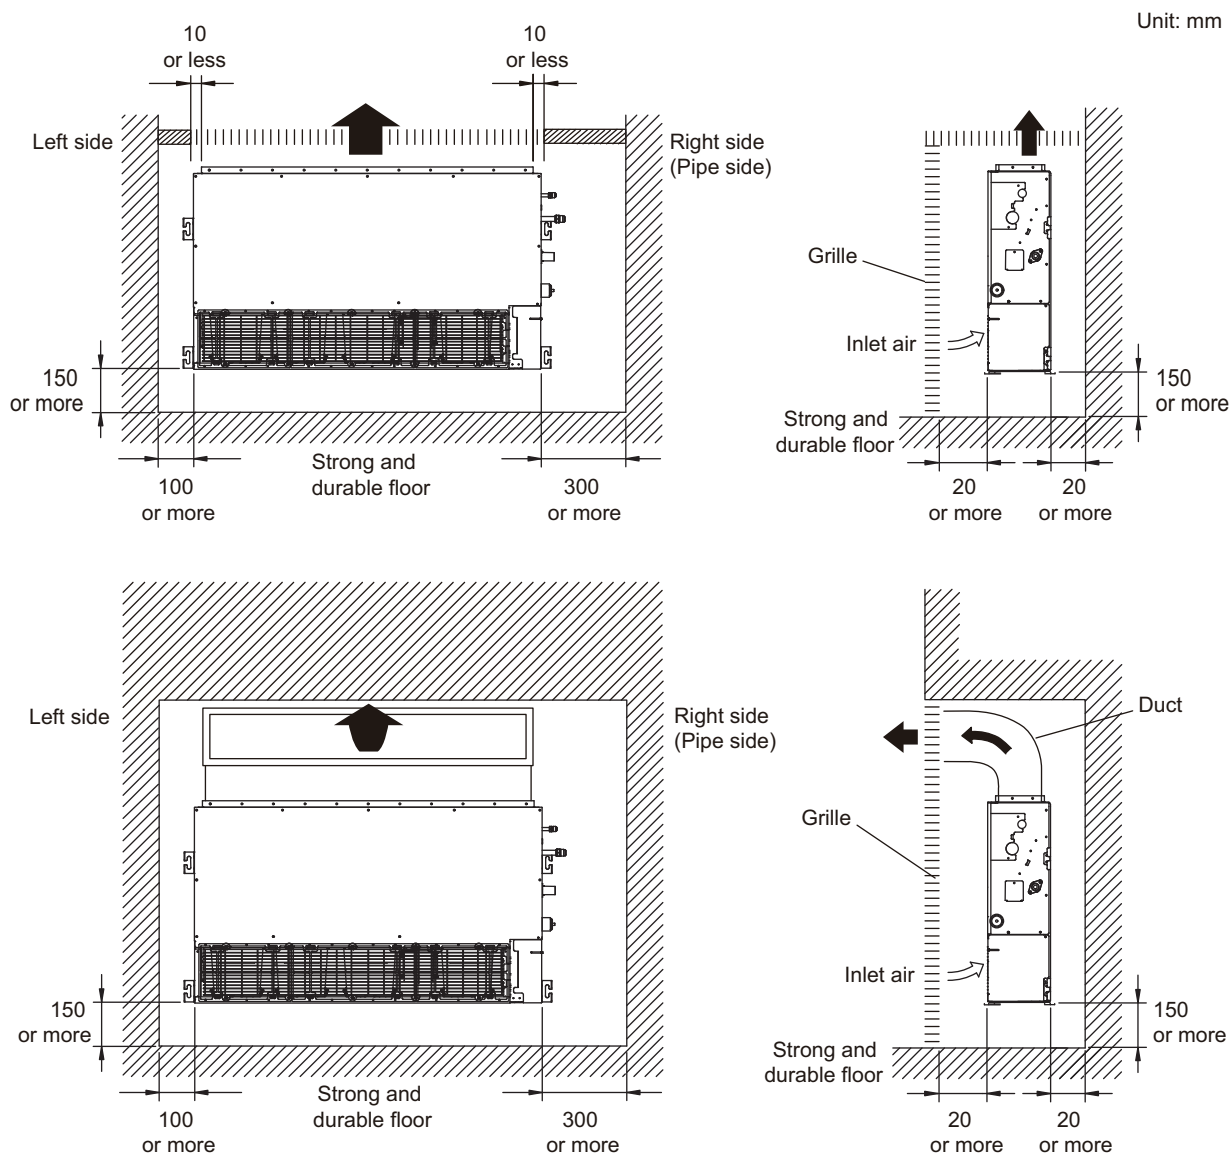

■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.

NOTE: Do not place any wiring or illumination in the maintenance space, as they will impede service.

