


VRF SYSTEM GROUP REMOTE CONTROLLER (WIRED TYPE) UTY-CGG*

INSTALLATION MANUAL



For authorized service personnel only.

English

中文

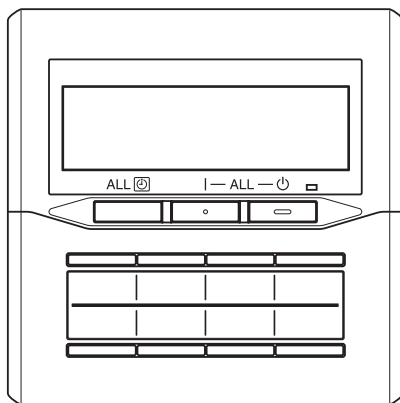


Contents


1. SAFETY PRECAUTIONS	2
2. ACCESSORIES	3
3. ELECTRICAL REQUIREMENT	3
4. SELECTING AN INSTALLATION LOCATION	
4.1. Dimensions	3
4.2. Name of parts	3
5. INSTALLING THE REMOTE CONTROLLER	
5.1. Flow of installation	4
5.2. Wiring	4
5.3. Installation	5
5.4. Setting the DIP switch	6
6. SYSTEM SETTING	
6.1. Explanation of terms	6
6.2. Turning on the power	7
6.3. Setting	7
6.4.  Remote controller settings	7
6.5.  Indoor unit registration	8
7. ERROR CODE DISPLAY	10

1. SAFETY PRECAUTIONS

- The "SAFETY PRECAUTIONS" indicated in the manual contain important information pertaining to your safety. Be sure to observe them.
- For details of the operation methods, refer to the operating manual.
- Request the user to keep the manual on hand for future use, such as for relocating or repairing the unit.






 WARNING	This mark indicates procedures which, if improperly performed, might lead to the death or serious injury of the user.
<ul style="list-style-type: none"> • Perform electrical work by an authorized service personnel in accordance with the installation manual and the electrical wiring regulations or implementation regulations of the country. Also do not install this unit by yourself. Improper electric work will cause electric shock or a fire. 	
<ul style="list-style-type: none"> • Perform installation work in accordance with the installation manual. Request an authorized service personnel to perform installation work. Do not install this unit by yourself. Improper installation will cause injury, electric shock, fire, etc. 	
<ul style="list-style-type: none"> • In the event of a malfunction (burning smell, etc.), immediately stop operation, turn off the electrical breaker, and consult authorized service personnel. 	
<ul style="list-style-type: none"> • Install a leakage circuit breaker to power supply cable in accordance with the related laws and regulations and electric company standards. 	
<ul style="list-style-type: none"> • Use a power source exclusively for this unit. Never share the power source with other electrical equipment. Doing so will cause fire and electric shock. 	
<p>Do not install the unit in the following areas:</p> <ul style="list-style-type: none"> • Do not install the unit near a source of heat, steam, or flammable gas. • Area filled with mineral oil or containing a large amount of splashed oil or steam, such as a kitchen. It will deteriorate plastic parts, causing the parts to fall or the unit to leak water. • Area that generates substances that adversely affect the equipment, such as sulfuric gas, chlorine gas, acid, or alkali. It will cause the copper pipes and brazed joints to corrode, which can cause refrigerant leakage. • Area containing equipment that generates electromagnetic interference. It will cause the control system to malfunction, preventing the unit from operating normally. • Area that can cause combustible gas to leak, contains suspended carbon fibers or flammable dust, or volatile inflammables such as paint thinner or gasoline. If gas leaks and settles around the unit, it can cause a fire. • Do not use the unit for special purposes, such as storing food, raising animals, growing plants, or preserving precision devices or art objects. It can degrade the quality of the preserved or stored objects. • Install the unit in a well-ventilated place avoiding rains and direct sunlight. 	

<ul style="list-style-type: none"> • Do not operate this unit when your hands are wet. Touching the unit with wet hands will cause an electric shock.
<ul style="list-style-type: none"> • If children may approach the unit, take preventive measures so that they cannot reach the unit.

 CAUTION	This mark indicates procedures which, if improperly performed, might possibly result in personal harm to the user or damage to property.
<ul style="list-style-type: none"> • Pay abundant care when transporting this unit because it is a precision device. Improper transportation will cause trouble. 	
<ul style="list-style-type: none"> • Do not touch the switches with sharp objects. Doing so will cause injury, trouble, or electric shock. 	
<ul style="list-style-type: none"> • Do not expose this unit directly to water. Doing so will cause trouble, electric shock, or heating. 	
<ul style="list-style-type: none"> • Do not set vessels containing a liquid on this unit. Doing so will cause heating, fire, or electric shock. 	
<ul style="list-style-type: none"> • Dispose of the packing materials safely. Tear and dispose of the plastic packing bags so that children cannot play with them. There is the danger of suffocation if children play with the original plastic bags. 	

2. ACCESSORIES

The following installation parts are supplied. Use them as required.

Name and Shape	Q'ty	Application
Installation manual 	1	This manual
Operating manual 	1	Instruction book for operation
Label 	4	Use this for writing the names of the indoor units that have been registered.
Screw (M4 × 16 mm) 	2	For installing the remote controller
Binder 	1	For remote controller and remote controller cable binding

Use of this product requires a special convertor and remote controller cable.

These are provided as service parts, so please contact authorized service personnel.

3. ELECTRICAL REQUIREMENT

When connecting the Group remote controller and the Convertor, use the following wiring.


Use	Size	Wire type	Remarks
Remote controller cable	0.33 mm ²	22AWG Polar 3 core, Twisted pair	Use shield cable.

We recommend that you purchase our service parts for the remote controller cable. Contact service personnel to purchase this.

4. SELECTING AN INSTALLATION LOCATION


4.1. Dimensions

Unit : mm (in.)

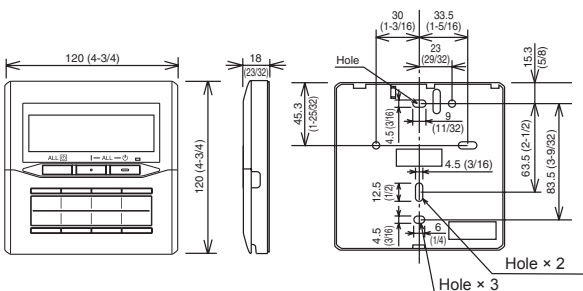


4.2. Name of parts

● With cover open

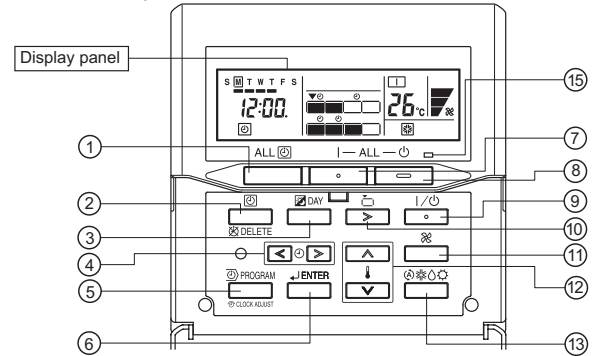


* The display is the same with the cover open or closed.

● With cover closed

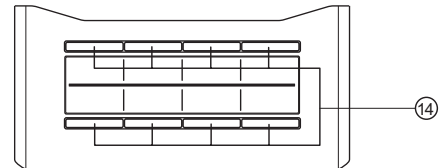

● Display panel

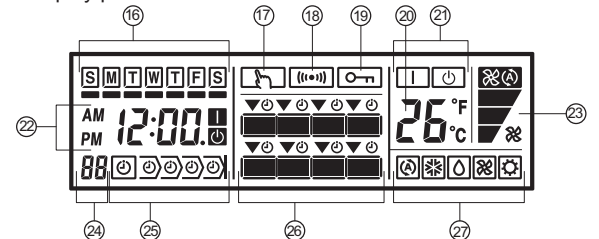


- ① "ALL" (All Timer Button)
- ② "DELETE" (Timer Mode/Delete Button)
- ③ "DAY" (Day Button)
- ④ "Set Time" (Set Time Button)
- ⑤ "PROGRAM / CLOCK ADJUST" (Program/Clock Adjust Button)
- ⑥ "ENTER" (Enter Button)
- ⑦ "I-ALL" (All ON Button)
- ⑧ "ALL-OFF" (All OFF Button)
- ⑨ "I/O" (Start/Stop Button)
- ⑩ "Select" (Select Button)
- ⑪ "Fan Control" (Fan Control Button)
- ⑫ "Set Temperature" (Set Temperature Button)
- ⑬ "Mode" (Mode Button)
- ⑭ (ON/OFF Button)
- ⑮ Operation Lamp
- ⑯ Day Display
- ⑰ Setting Display
- ⑱ Transmission Display
- ⑲ Operation Lock Display
- ⑳ Temperature Display
- ㉑ ON/OFF Display
- ㉒ Timer and Clock Display
- ㉓ Fan Speed Display
- ㉔ Remote Controller Address Display
- ㉕ Timer Mode Display
- ㉖ Indoor Unit Operation Indicators
- ㉗ Operation Mode Display

5. INSTALLING THE REMOTE CONTROLLER


5.1. Flow of installation

The following is the flow of the installation of Group remote controller.

• INSTALLATION

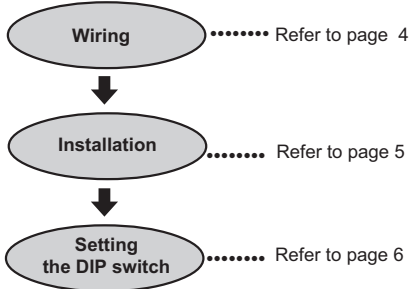

• SETTING

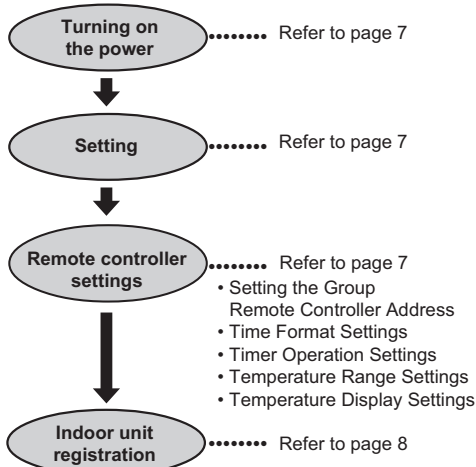

5.2. Wiring


⚠ WARNING

- Before starting installation work, turn off the power of this unit and the connection destination. Do not turn on the power again until installation is completed. Otherwise, it will cause electric shock or fire.
- Use the accessories or specified power cable and connection cables. Do not modify power cable and connection cables other than those specified, do not use extension cords, and do not use independent branch wiring. The allowable current will be exceeded and cause electric shock or fire.
- Install the connection cables securely to the terminal block. Confirm that external force is not applied to the wire. Use connection cables made of the specified wire. If intermediate connection or insertion fixing are imperfect, it will cause electric shock, fire, etc.
- When connecting the power cable and transmission cable, layout the wiring so that the cover of this unit is securely fixed. If the cover is imperfectly fixed, it may cause fire or overheating of the terminals.
- Perform ground work positively. Do not connect the ground wire to a telephone ground wire, water pipe, or conductor rod.
- Always fasten the outside covering of the connection cord with the cord clamp. (If the insulator is chafed, electric leakage may occur.)
- When performing cable wiring work, be sure that it does not touch the user. Doing so will cause injury or electric shock.
- If any cable is damaged, do not repair or modify it yourself. Improper work will cause electric shock or fire.


⚠ CAUTION

- Do not wire the remote controller cables and the transmission cable together with or parallel to the connection cable, transmission cables, and power supply cables of the indoor and outdoor units. It may cause erroneous operation.
- When performing wiring work, be careful not to damage the cable or injure yourself. Also, connect the connectors securely. Loose connectors will cause trouble, heating, fire, or electric shock.
- Install the indoor and outdoor units, power cable, signal cable and remote control cable 1 m away from television and radio to avoid distorted images and noise.
- Perform wiring so that water does not enter this unit along the external wiring. Always install a trap to the wiring or take other countermeasures. Otherwise it will cause trouble or electric shock or fire.
- Confirm the name of each unit and name of each terminal block of the unit and connect the wiring in accordance with the directions given in the manual so that there is no incorrect wiring. Incorrect wiring will damage the electric parts and cause smoke and fire.
- When installing the connection cable near a source of electromagnetic waves, use shielded cable. Otherwise, a breakdown or malfunction could result.

(1) When connecting 1 Group remote controller

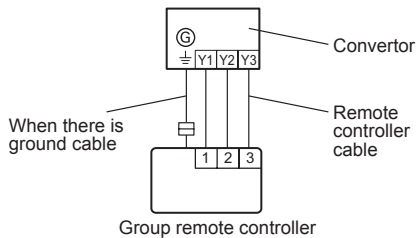


- Total remote controller cable length: MAX. 100 m (328 ft.)

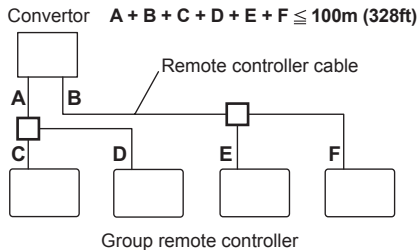

(2) When multiple Group remote controllers are connected

- A maximum of 4 Group remote controllers can be connected with 1 Converter.
- Use of a terminal box is recommended when a junction is made in the wiring.

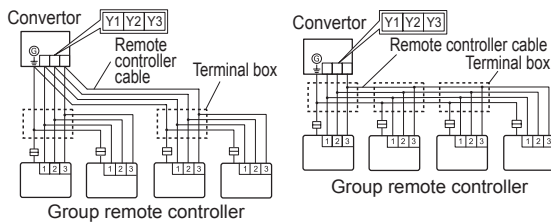

When connecting the group remote controllers to the converter terminals, observe the following precautions.

- Do not connect more than 4 remote control cables to 1 converter.
- Do not connect more than 1 remote control cable using the same screw.

5.3. Installation

WARNING

- Always use the accessories and specified installation work parts. Check the state of the installation parts. Not using the specified parts will cause units to fall off, water leakage, electric shock, fire, etc.
- Install at a place that can withstand the weight of the unit and install positively so that the unit will not topple or fall.
- When installing this unit, make sure that there are no children nearby. Otherwise, injury or electric shock could result.
- After installing this unit, perform the test run to confirm that the unit is operating properly. Then, explain the operation of this unit to the customer.

CAUTION

- Do not set the DIP switch or rotary switch of this unit except as specified in this installation manual or the instruction manual supplied with the air conditioner. Setting the switches other than specified will cause an accident or trouble.
- Use an insulated screwdriver to set the DIP switches.
- Before opening the case of this unit, completely discharge static electricity charged on you body. Not doing so will cause trouble.
- Do not touch the circuit board and circuit board parts directly with your hands. Otherwise, injury or electric shock could result.
- Tightening the mounting screws too tight will damage the case of this unit.
- Be careful so that the front cover does not fall after the front cover screws are removed. Otherwise, injury could result.

Open the operation panel on the front of the remote controller, remove the 2 screws indicated in Fig. 1 and then, remove the front case of the remote controller.

NOTES

When open the remote controller, remove the connector from the front case. The cables may break if the connector is not removed and the front case hangs down. When installing the front case, connect the connector to the front case. When removing and connecting the connector, be careful not to break the cables. Be careful to insert the connector completely.

- (1) Pass the remote controller cable through the hole in the rear case and connect the remote controller cable to the remote controller terminal block specified in Fig. 2.
- (2) Wrap the connector and remote controller cables with vinyl tape or some other type of insulation as shown in Fig. 2.
- (3) Clamp the remote controller cable sheath with the binder as shown in Fig. 2.
- (4) Cut off the excess binder.
- (5) Install the rear case to the wall, box, etc., with 2 screws (M4 × 16mm). Fix the 2 screws in either horizontal or vertical position. (Fig. 3)

Fig. 1



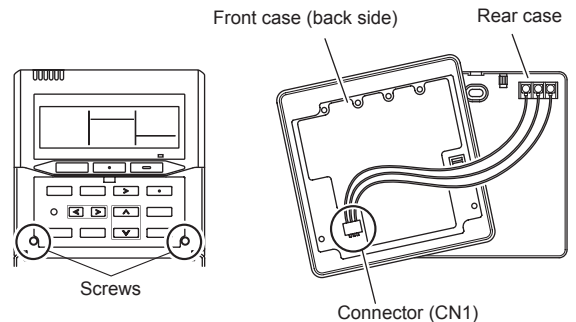


Fig. 2

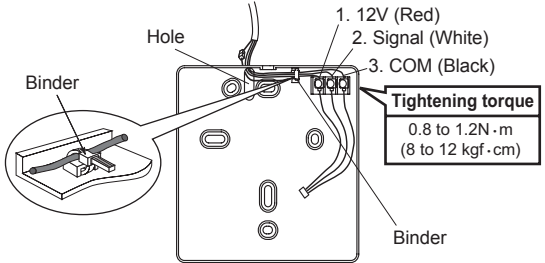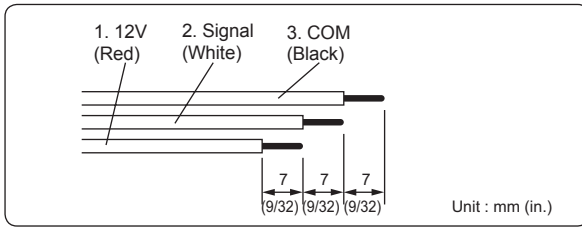

CAUTION
Be careful to avoid breaking the cable by over-tightening the binder.

CAUTION
When connecting the remote controller cables, do not over-tighten the screws.





Fig. 3 [Example]

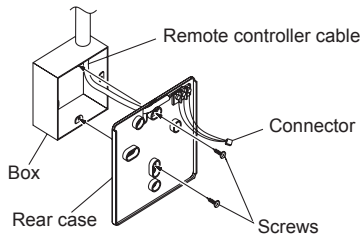

5.4. Setting the DIP switch

Set DIP switch No. 1 to ON to enable the memory backup of time information.

• Memory backup setting


If the DIP switch No. 1 is not set to ON, the current time information will be lost if there is a power failure.

* Registered information, such as that for the internal unit, is not erased even if the DIP switch is turned off.

	NO.	Switch state	
		OFF	ON
DIP switch	1	★ Invalidity	Validity
	2	★ Fixed at OFF	

(★ Factory setting)


Front case (back side)

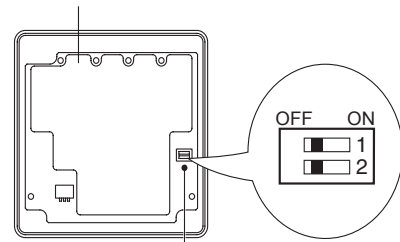

DIP Switch

6. SYSTEM SETTING

6.1. Explanation of terms

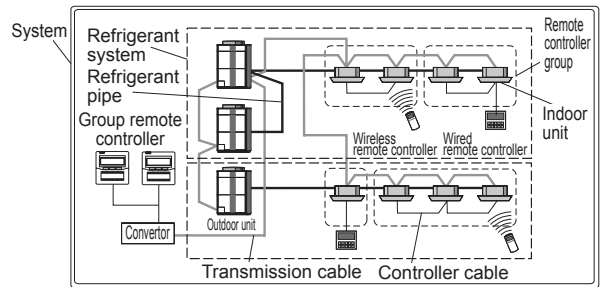

Controller related items

• System:

This is all of the indoor units, outdoor units and controller units connected by the same transmission cable.

• Refrigerant system:

This is a system composed of indoor and outdoor units connected by the same refrigerant pipe.

• Remote Controller group:

This is the smallest unit controlled by group remote controller.

This is a group of indoor units that have been connected with a remote controller cable.

Indoor / Outdoor unit setting (on the circuit board)

• Refrigerant circuit address (0~99):

This is the ID individually assigned to each refrigerant system and is used for control.

• Indoor unit address (0~63):

This is the ID individually assigned to each indoor unit and is used for control.

• Remote controller address (0~15):

This is the ID individually assigned to the indoor units forming each remote controller group and is used for control.

Group remote controller setting

• Group remote controller address (0~3):

This is the ID individually assigned to each group remote controller.

6.2. Turning on the power

CAUTION

- Recheck the wiring. Incorrect wiring will cause trouble.

Turning on the power

Once the installation and wiring has been completed, use the following procedure to turn on the power.


1. Install the front case.
 - * When installing the front case, connect the connector to the front case (in 5. INSTALLING THE REMOTE CONTROLLER).
2. Check the indoor and outdoor unit wiring and circuit board switch settings, and then turn on the power of the indoor and outdoor units.
 - (1) Turning on the power for all connected indoor units.
 - (2) Turning on the power for all connected outdoor units.
 - (3) Turning on the power for all connected converter of group remote controllers.

Wait for 1 minute or more after turning on the power before performing the next section.


6.3. Setting

Switching to the Settings Screen

Initial Screen



Hold down the “◀▶” button and “▶▶” button simultaneously for 2 seconds or more to start the Settings.

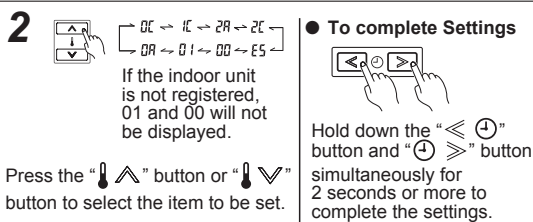

Settings 0C : Remote controller settings → Page 7
 1E : Indoor unit registration → Page 8
 2R, 2C, 05, 00, 01, 0R : Forbidden



NOTES

When there is a display other than the initial screen, it is possible that an error has occurred. Please consult authorized service personnel in such cases.

6.4. Remote controller settings


Remote Controller Settings

Initial Screen

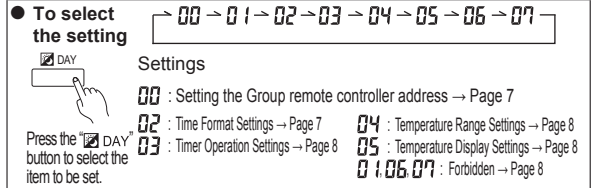


Setting the Group Remote Controller Address

To set the Group remote controller address

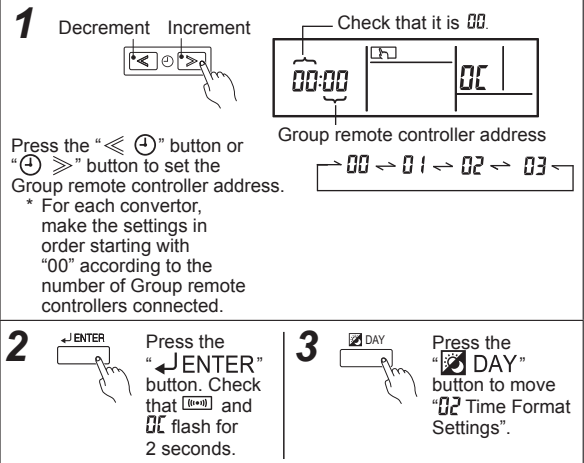



Time Format Settings (This switches the time format.)

To switch the time format



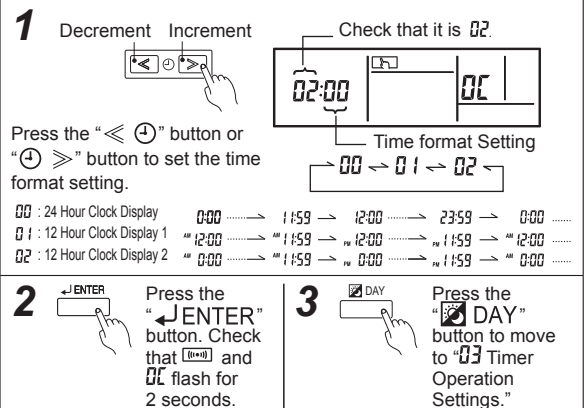



03 Time Operation Settings (This enables/disables the weekly timer.)

To enable/disable timer operation

1 Decrement Increment

 Check that it is 03.

 Time operation setting
 00 ← 01
 Enabled Disabled



Press the “◀ ⌚” button or “⌚ ▶” button to set the timer operation.

2  Press the “ENTER” button. Check that  and  flash for 2 seconds.

3  Press the “DAY” button to move to “04 Temperature Range Settings.”

04 Temperature Range Settings (This changes the temperature range.)




To set the temperature range


1 Decrement Increment

 Check that it is 04.

 Temperature range setting
 00 ← 01

Press the “◀ ⌚” button or “⌚ ▶” button to set the temperature range.

- The temperature range set for heating operation is different.



00 : 10 °C – 30 °C (48 °F – 88 °F)
 01 : 16 °C – 30 °C (60 °F – 88 °F)

2  Press the “ENTER” button. Check that  and  flash for 2 seconds.




3  Press the “DAY” button to move to “05 Temperature Display Settings.”


05 Temperature Display Settings (This switches the display between Celsius and Fahrenheit.)

To switch the temperature display

1 Decrement Increment

 Check that it is 05.

 Temperature display setting
 00 ← 01
 Celsius Fahrenheit



Press the “◀ ⌚” button or “⌚ ▶” button to set the temperature display.

2  Press the “ENTER” button. Check that  and  flash for 2 seconds.

3  Press the “DAY” button three times to move to “00 Setting the Group remote controller address.”

01, 06, 07 Forbidden


To move to the following settings

1 


- 01 Forbidden**
 Press the “DAY” button to move to “02 Time Format Setting.”
- 06, 07 Forbidden**
 Press the “DAY” button to move to “00 Setting the Group remote controller address.”

Moving to “INDOOR UNIT REGISTRATION”

To move to indoor unit registration




Press the “↑ ↓” button once or press the “↑ ↓” button 7 times to move to indoor unit registration.

6.5. Indoor unit registration



- A maximum of 8 remote controller groups can be registered for a Group remote controller.
- A maximum of 2 refrigerant circuit addresses can be registered for each group remote controller (maximum of 4) that is connected to a single convertor.
- The remote controller groups registered can be monitored and controlled.
- Confirm the number set and location (room) for each indoor unit with the user.
- Perform registration after connecting the indoor units to be registered to the respective outdoors units and turning on the power.
- Cannot be operated within 4 minutes after the start up.



Indoor unit registration screen

Initial Screen
 See Explanation of terms on page 6 for explanations of each address.

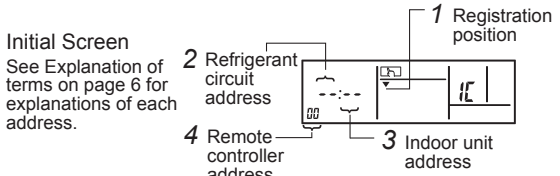

To register indoor units

1 ● Registration position selection


 Press the “▶” button to select the position for registering the indoor unit


2 ● Refrigerant circuit address selection


 Press the “DAY” button to select the refrigerant circuit address for the indoor unit being registered.

- Hold down the “◀ ⌚” button or “⌚ ▶” button to scroll through the addresses quickly.

3-1 When a remote controller group made up of a single indoor unit is registered, select the indoor unit address.

● **Indoor unit address selection**

Decrement Increment




Press the “◀ Ⓞ” button or “Ⓞ ▶” button to select the indoor unit address for the indoor unit being registered.

- Hold down the “◀ Ⓞ” button or “Ⓞ ▶” button to scroll through the addresses quickly.

3-2 When a remote controller group made up of multiple indoor units is registered, the remote controller address and the indoor unit address are selected.



● **Remote controller address selection**




- Please set Remote controller address start from “00” to “15” in turn.
- An indoor unit, of which Remote controller address is “00”, is automatically set to “Master unit” in a Remote controller group consisting of multiple indoor units.

● **Indoor unit address selection**

Decrement Increment

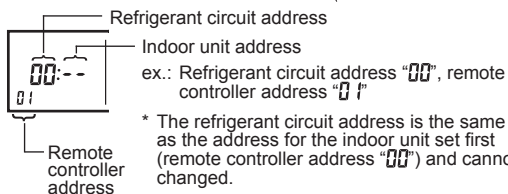

1. Press the “Ⓞ PROGRAM / Ⓞ CLOCK ADJUST” button to select the remote controller address of the indoor unit being registered.
2. Press the “◀ Ⓞ” button or “Ⓞ ▶” button to select the indoor unit address of the indoor units in the same remote controller group that is being registered.
3. Repeat steps 1 and 2 to register all the indoor units in this remote controller group.




Press the “↵ ENTER” button to register the selected indoor unit. Check that the refrigerant circuit address, indoor unit address, and registration is completed when the display stops flashing (flashes for 4 minutes). After the start up for 4 minutes, indoor unit cannot be registered.

- Press the “Ⓞ / ✕ DELETE” button during this time to cancel the registration.

5

Repeat steps from 1 to 4 to register other indoor units.

● **To delete the registered settings**




1. Press the “Ⓞ / ✕ DELETE” button during steps 2 to 3 reset the contents of the registration. (If the currently displayed indoor unit is part of a remote controller group with multiple units, only the settings for this indoor unit are reset.)
2. Press the “↵ ENTER” button to delete the contents of the registration.
3. Please delete Remote controller address with the exception of “00” before delete Remote controller address “00”.

NOTES

- (1) Be careful not to end the settings or switch the indoor unit before pressing the “↵ ENTER” button. Otherwise, the changed settings will be lost.
- (2) If EE: 15 is displayed during the registration of an indoor unit, the Group remote controller address, refrigerant circuit address, or indoor unit address may be incorrect. Check again.

Moving to “REMOTE CONTROLLER SETTINGS”


To set the remote controller



Press the “⬆ ⬆” button 7 times or press the “⬆ ⬆” button once to move to remote controller settings.

Completing All of the Settings

To complete Settings



- **When the remote controller settings and indoor unit settings are complete**
Hold down again the “◀ Ⓞ” button and “Ⓞ ▶” button simultaneously for 2 seconds or more to complete Settings.




FINAL STEP

To apply the label

Conference Room 1	Conference Room 2	Conference Room 3	
Office 1	Office 2	Hall	Drawing Room

Label (Accessories)
84 × 21 (3-9/32 × 13/16)




Write the name of the indoor unit or the room where it is installed on the label, and apply it to the Group remote controller.

- Consult the customer about the names to be written on the label.
- Explain to the customer about the indoor units that have been registered to each button.

7. ERROR CODE DISPLAY

The air conditioning system must be inspected if “E*:**” (error code) appears on the Timer and Clock Display, or the operation lamp is flashing.

The following explains the meaning of each of the error codes.

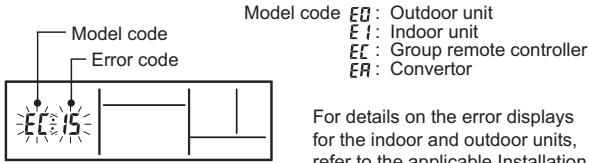

Ex. Error code display

Model code **E0**: Outdoor unit
E1: Indoor unit
E2: Group remote controller
E3: Converter

For details on the error displays for the indoor and outdoor units, refer to the applicable Installation Manual.

Error code table of Controller and Converter

Error Code	Contents
12	Remote controller communication error
14	Network communication error
15	Scan error
26	Address setting error
28	Other setting error
C1	Main PCB error
C4	Group remote controller hardware error
CA	EEPROM error

i NOTES

When “**L00**” is displayed on the time display, it means that the priority is given to the bus. In this case, the remote controller is not operative.

In case “**ac**” is indicated, it means under maintenance. When the indoor unit registration is performed by the System Controller, Touch Panel Controller, etc., “**ac**” may be displayed up to 15 minutes after the completion of maintenance.