


### 3-3. UTZ-BD080C, UTZ-BD100C

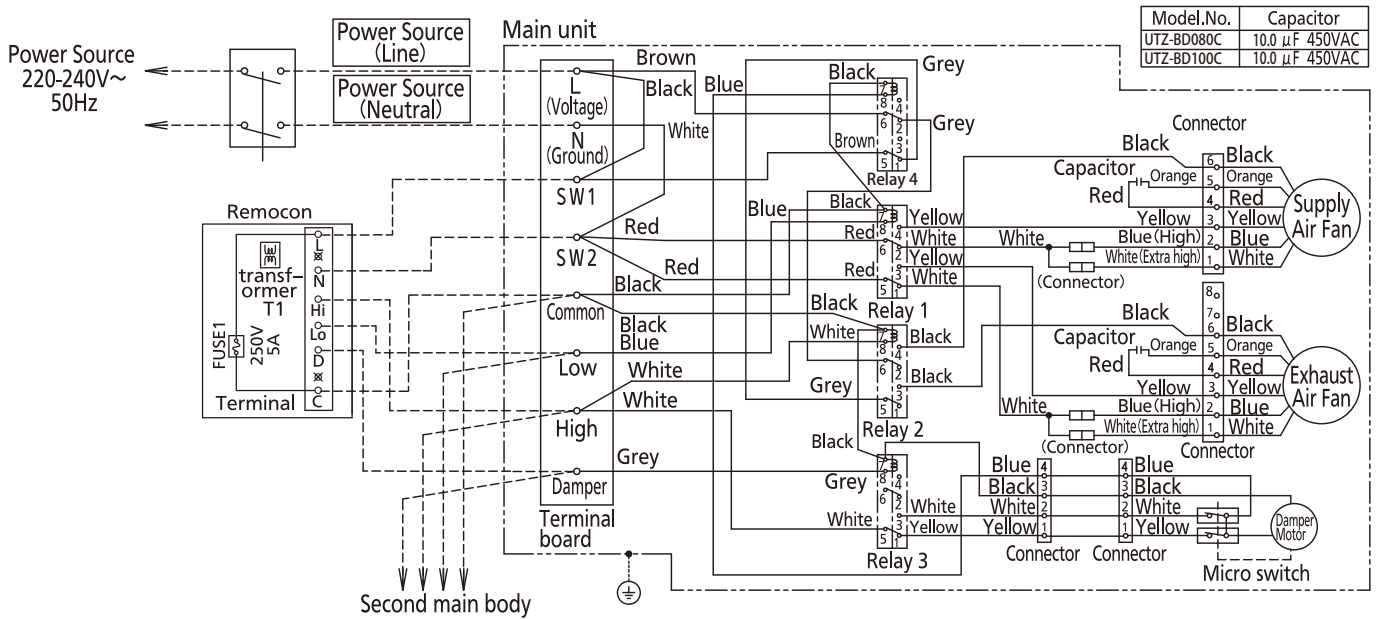

### ■ ELECTRIC WORKS

If a large volume of air is required or a long duct is used, switch the wire connection from Low to Extra high according to the following steps:

- Remove two screws securing the cover of the electrical components box, and open the cover .
- In the electrical components box, change the connection of fan motor leads from High to Extra high.

